

48

**REPAIR OF BIOMEDICAL EQUIPMENTS UNDER BIOMEDICAL EQUIPMENT
MAINTENANCE PROGRAM (BEMP)**

Recommendations for Beyond Economic Repair (BER)

PROFORMA

Sl. No	Particulars	Details
1	Name of District	Pathanamthitta
2	Name of Hospital	Gr. H Pathanamthitta
3	Name of Equipment with Make, Model and Serial Number	U.P.S HYKON BIS 1000 19040076
4	Equipment ID & Barcode	0310056
5	Date of purchase / Year of manufacture / Installation Date	2018
6	Warranty details (Yes/No)	N/A
7	*AMC/ CAMC Period agreed at the time of purchase	N/A
8	Date of breakdown (Date of registration of complaint through email/ Toll free)	07/10/2023
9	Action taken	Recommended for BER
10	Present status of the equipment (Fully damaged / partially damaged)	Present Fully Damaged.
11	Recommendations for repair (required service details)	Not Serviceable
12	Cost of spares (specify parts and cost)	Not Applicable.

Date

Seal

GENERAL HOSPITAL
PATHANAMTHITTA

SUPERINTENDENT
GENERAL HOSPITAL
PATHANAMTHITTA

Signature of Superintendent / Medical Officer (t/c)

11-10-2023
Handwritten text

Remarks and Recommendations of Junior Consultant (Biomedical) NHM:

Recommend for BER as per rule.

Signature of JC BM (NHM)

CONSULTANT (BIOMEDICAL)
NATIONAL HEALTH MISSION
PATHANAMTHITTA

* Attach Photograph

*Not mandatory #Based on the period of life and value as per the BER guidelines

13	Asset Value	4500/-
14	# Percentage value of the cost of spares with respect to Cost of Purchase/ Asset Value	Not Applicable
15	Abstract of Service Report provided by the OEM/ Authorized Service Provider/ CYRIX (Attached or Not)	Yes
16	Reasons for recommending the equipment as BER	Battery and Board - Complaint. Report received from OEM. Equipment is not serviceable.
17	Name & Signature of CYRIX Authority	Shiju John Chacko



**BIOMEDICAL EQUIPMENT
MAINTENANCE PROGRAMME
UNDER
NATIONAL HEALTH MISSION**



SERVICE PROVIDER
Tender No. WO-37/2021-2022/698

CYRIX
HEALTHCARE PVT LTD

No. : 152862

ISO 13485 : 2012 & ISO 9001-2008 CERTIFIED COMPANY | AERB Approved Service Agency

Service Report

30/64 1 B, Petta Junction, Poonithura, Kochi - 682 038, Kerala
Ph : 98472 99500 Website : www.cyrix.com | E-mail : bemp.kl@cyrix.in

Health Facility <i>G.H Pathanamthitta</i>	Call Registration Date : <i>07/10/2023</i>
Address <i>Pathanamthitta</i>	Caller ID : <i>73449</i>
<i>689645</i>	Date of Visit : <i>11/10/2023</i>
Ph : <i>9747955884</i>	Asset No. : <i>0310056</i>
	EQPT Name : <i>UPS</i>
	Manufacture <i>HYKON</i> Model : <i>BIS 1000</i>
	S. No. <i>19040076</i> Dept. <i>Laboratory</i>

Service Classification : Breakdown Call **PMS** **Calibration** **Cust.Training**

Problem Identified : *Not working, Battery and board Complaint.*

Action Taken : *Checked the machine, found that Battery and Board Complaint. Report received from OEM. Equipment is not serviceable. Recommended for BER.*

Completed **Date :** *11/10/2023* **Time :** *1:00pm.* **Spare Required**

Spare Replaced **Requested**

Description	Qty.	Part Number	PR Number
1.			
2. <i>-NA-</i>	<i>-NA-</i>	<i>-NA-</i>	<i>-NA-</i>
3.			






Cyrix Engineer	Date	Start Time	End Time
<i>Shiju John</i>	<i>11/10/23</i>	<i>10:00am</i>	<i>1:00pm.</i>

Customer Remark **Completed** **Pending**



Service Engineer Name : <i>Shiju John Chacko</i>	Customer Name : <i>Jincy M Joseph</i>
Signature : <i>[Signature]</i>	Signature : <i>[Signature]</i>
Date : <i>11/10/2023</i>	Date : <i>11/10/2023</i>
Contact Number : <i>9605381275.</i>	Contact Number : <i>9447014242</i>
	Designation : <i>Senior Lab Technician</i>
	Hospital Seal : <i>[Seal]</i>



Contact number: 2751852
 Date: 11/10/2023
 Signature: 
 Service Engineer Name: Jatin J. J.

Hospital name: 
 Designation: 
 Contact number: 
 Date: 
 Signature: 







Sl. No.	Description	Part number	SR number
1	AM	AM	AM
2	AM	AM	AM
3	AM	AM	AM

Completed Date: 11/10/23 Time: 1:00 PM
 Service required

Problem identified: 
 Action taken: 

Service classification: Breakdown call - PMS

Name:  Address:  Hospital Name: 	Call no: 2751852 Date: 11/10/23 Time: 1:00 PM Signature: 
---	---

Service robot: 

HEALTHCARE PART LTD
CYBIX
 No: 125825

NATIONAL HEALTH MISSION UNDER MAINTENANCE PROGRAMME BIOMEDICAL EQUIPMENT





Powering the Nation

(A) L100 / 2000 COMPANY

Hykon India Ltd.,

Hykon House, Khande Wadia Road, Thiruvani, Tele/Fax: 242527 Ph: 244183, 244181

Thruster Inverter Triandun Galva Kante Evert Charka Mission Sargara Palkad Coimbatore

Hyderabad



Helpline: 18604250121

Date: 10/10/23

No: 22488

Ref. No.

Name & Address

General Hospital
Pathanamthitta

Make/Model

DL5 1000

Capacity

110/24V

Serial No.

11040076

Battery Make/Model/AH/No.

7AH x 2

Used Desktop PC Yes No

Other loads

Dot matrix/Inkjet Printer Yes No

Laser printer Yes No

Lights & Fan YES NO

PH No

7967 816872

Contact Person

Invoice No.

Invoice Date

e-mail ID

Free Service Done YES NO

Type of Call

INST

WP

DOWP

AMC

Door Panel/Window

Nature of problem reported - Not charging of main or battery

Defects found on inspection - Checked the UPS & battery

UPS power board is burned due to high voltage. System not suitable

ESTIMATE

Cost of spares

Service charge

Total

Status after service

Completed

Spare/PCB Replaced

System/Battery Replaced System (Battery) No

Incomplete

Pending for spare

Battery/System/PCB Taken for service

Battery Compliant

Standby provided Standby No

INPUT VOLTAGE

OUTPUT VOLTAGE

R-N 220

R-N

Y-N

Y-N

B-N

B-N

E-N 25

E-N

Troble Voltage

Volt

Charging Current

Amp

Water Level

NORMAL

FILLED

MPPT IN Volt

Gravity Level

LOW

NORMAL

MPPT OUT Volt

Connector checked

YES

NO

MPPT IN Amp

Battery bank health

GOOD

BAD

MPPT OUT Amp

V AH

not. Battery found compliant/weak. to be replaced the

vauly batteries. If battery is in WP, gravity of each cell should be mention behind the report.

System Premises Clean Yes No

Air Condition Yes No

Ventilation Yes No

Site environmental status/Recommendations

System not suitable - suggest new one.

CUSTOMER FEEDBACK:

Customer: Suggestions if any

Excellent (5*) Good (4*)


Satisfactory (3*) Fair (2*) Poor (1*)

Customer Signature & Seal

Name of Engineer (For)

Signature



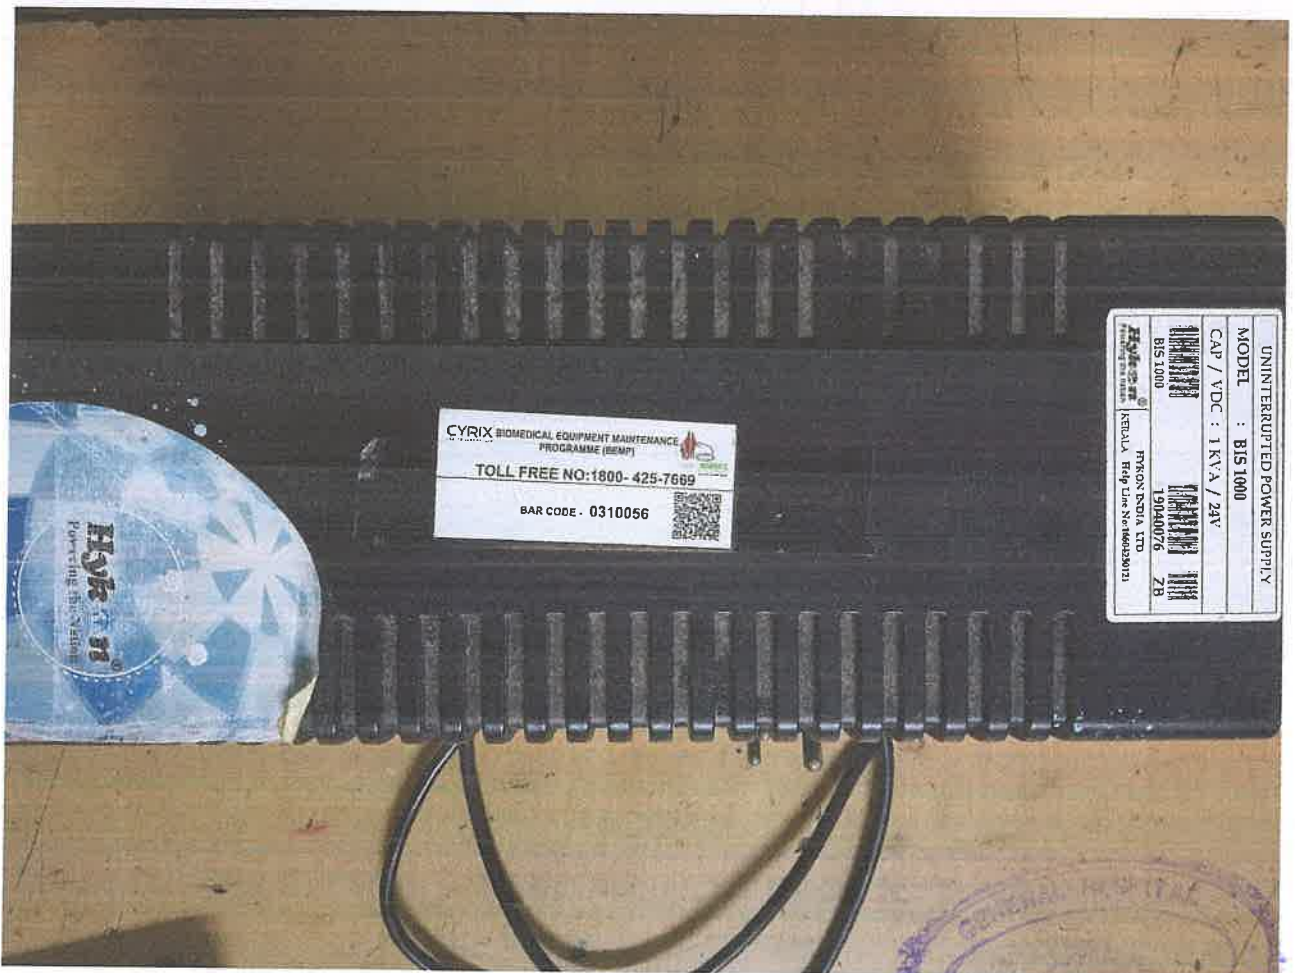

CYRIX BIOMEDICAL EQUIPMENT MAINTENANCE PROGRAMME (BEMEP)
TOLL FREE NO: 1800-425-7689
BAR CODE - 0310056

UNINTERRUPTED POWER SUPPLY	
MODEL	: BIS 1000
CAP / VDC	: 1 KVA / 24V
BIS 1000	
HYKON-INDIA LTD	
KERALA, Help Line No 049530121	
ZB	



