





**PROFORMA
RECOMMENDATION FOR BEYOND ECONOMIC REPAIR (RBER)
BIOMEDICAL EQUIPMENT MAINTENANCE PROGRAM (BEMP)**

Name of Hospital: THQH CHITTUR	Name of District: PALAKKAD
Name of Equipment: UPS	Equipment ID & Barcode: #142341 -0920202
Make: DELTA	Model: N-2K
Serial Number: NA	Warranty details: No Warranty
Date of purchase/Year of manufacture/ Installation Date: In ticket master installation date 05/09/2018, As per stock installation date is 07/09/2018 (stock book attached for reference)	Present status of the equipment: Fully damaged
Date of breakdown: 23/10/2024 Date of registration of complaint through email/Toll free): Toll free	*AMC/ CAMC Period agreed at the time of purchase: No AMC/CAMC
Action taken: Checked the ups found automatically shut down. Found Problem with PCB 5505003192 need to be replace this spare for further checking of machine.	
Recommendations for repair (required service details): No recommendations	
Cost of spares (specify parts and cost): PCB 5505003192 = 22420/-	
#Percentage value of the cost of spares with respect to Cost of Purchase/ Asset Value: 498.2%	Asset Value: 4500/-
Abstract of Service Report provided by the OEM/ Authorized Service Provider/ CYRIX (Attached or Not): Cyrix Service report attached and quotation attached.	
Reasons for recommending the equipment as BER: Checked the ups found automatically shut down. Found Problem with PCB 5505003192 need to replace this for further checking of machine. In ticket master installation date is 05/09/2018, As per the stock book Equipment installed on 07/09/2018 aged up to 6 years 2 months. Repairing cost is more than 100% both criteria for RBER met. As per tender clause 5.3.14.1 we recommending for condemnation.	
AKHILESH P  Name & Signature of CYRIX Authority with date	
Remarks of Junior Consultant (Biomedical) NHM: ups installed on 7/09/2018 aged up to 6 years. Repairing cost exceeds the asset value. Both criteria of RBER met.	
Recommended for BER (Yes/ No): Yes	 Signature of Junior Consultant (Biomedical Engineering) Palakkad, Palakkad (NHM)
Date: 4/11/24	
Date:	 Signature of Superintendent / Medical Officer (i/c) Taluk Head Quarters Hospital Chittur - Palakkad



*Not mandatory

#Based on the period of life and value as per the BER guidelines. Attach Photograph



**BIOMEDICAL EQUIPMENT
MAINTENANCE PROGRAMME
UNDER
NATIONAL HEALTH MISSION**



SERVICE PROVIDER
Tender No. WO-37/2021-2022/698

No : 1021893

CYRIX[®]
HEALTH CARE PVT LTD

ISO 13485 : 2012 & ISO 9001-2008 CERTIFIED COMPANY | AERB Approved Service Agency

Service Report

30/64 1 B, Petta Junction, Poonithura, Kochi- 682 038, Kerala
Ph : 98472 99500 Website :www.cyrinx.com | Email : bemp.kl@cyrinx.in

Health Facility..... <i>THOH Chittur</i>	Call Registration Date : <i>23-10-2024</i>
Address..... <i>Palakkad</i>	Caller ID : <i>142341</i>
..... <i>Kerala</i>	Date of Visit : <i>24-10-2024</i>
Ph:..... <i>09995196708</i>	Asset No : <i>0920202</i>
	EQPT Name : <i>UPS</i>
	Manufacture <i>Delta</i> Model : <i>N-2K</i>
	S. No. <i>881173004WL</i> Dept. <i>Lab</i>

Service Classification : Breakdown call PMS Calibration Cust. Training

Problem Identified : *Fault found in unit automatically shut down.*

Action Taken : *checked the unit found UPS automatically shut down. Found Problem with PCB 5505003192 need to be replace this spare for further checking of machine*

Completed Date : *24-10-2024* Time : *2:30PM* Spare Required

Spare Replaced Requested

Description	Qty.	Part Number	PR Number
1.			
2.			
3.			

Cyrinx Engineer	Date	Start Time	End Time
<i>ABIJITH-B</i>	<i>24-10-24</i>	<i>12:30 PM</i>	<i>2:30 PM</i>

Customer Remark Completed Pending

Service Engineer Name : *ABIJITH-B*
Signature: *[Signature]*
Date: *24-10-2024*
Contact Number: *9567164651*

AP
SUPPLY
Taluk Head Quarters Hospital
Chittur-675011
Palakkad

Customer Name : *Rakhi MR*
Signature: *[Signature]*
Date: *24/10/24*
Contact Number: *7558928501*
Designation : *Senior Lab Technician*
Hospital Seal



To,
CYRIX HEALTHCARE PVT LTD
Tripunithura
Ernakulam

APSS/KHI-SER/SK/24-25/018 01 November 2024

Subject : OFFER FOR APC Delta REPAIR

SI NO	Price Schedule	Qty	Rate	Price
1	PCB Delta N-2K UPS PCB - 5505003192	1	19,000	19,000.00
	Total Value Excluding TAX			19,000.00
	GST @18%			3,420.00
	Total Value Including TAX			22,420.00

Note : Terms & Conditions.

- Travel and labor expenses are included
 - Payment 100% Advance
 - Delivery of Service thru **Autopower**
 - Delivery : 30 working days (Depends The Availability)
 - Warranty - Nil
 - This contract includes replacement of units and the defective units will be taken back by Autopower
 - Pan No AAKFA6646E
 - Exclusions: The following will be outside the scope of this Agreement
 - This contract does not cover batteries, physical and liquid damages
 - Product Shifting / Relocation / disconnection & Reinstallation will not be covered under this contract.
- Please feel free to contact the undersigned for any clarifications
- Validity 15 Days
 - Payment terms : 100% advance payment along with workorder
- <> PO to be placed on :: **AUTOPOWER SYSTEMS & SOLUTIONS**

Thanking you in anticipation of your valuable order
Assuring you our best services at all times

Yours faithfully,
For Autopower Systems and Solutions

Sreekumar
9895334063



REQUIRED SPARE QUOTATION FOR 3KV UPS 0920202 # 142341 @ THQH CHITTUR , PALAKKAD

4 messages

Akhilesh P <akhileshcyrix@gmail.com>

Wed, 30 Oct, 2024 at 12:28 pm

To: service.apss@gmail.com <service.apss@gmail.com>

Cc: DM Sarang-KLBEMP <dm1.klbemp@cyrix.in>, Blesson Jose <Zm2.klbemp@cyrix.in>

Dear sir

Kindly share the price and stock availability of DRIVER CUM CHARGER PCB , CONTROL CARD for 3 kv ups @ THQH CHITTUR , PALAKKAD

Deatils are furnished below

Hospital Name : THQH CHITTUR

Equipment Name : 3kv UPS

Make : DELTA ELETRONICS

Model : UPS202N2002N0B0

SN: 88117300314WC

Barcode : 0920202

Thanks & Regards

AKHILESH P
DISTRICT INCHARGE - PALAKKAD
Bemp-Kerala
Mobile : +91 7593847154
Email : akhileshcyrix@gmail.com
CYRIX HEALTHCARE (P) LTD
30/641B, Petta, Punithura
Ernakulam- 682038
www.cyrixhealthcare.com

Sreekumar Autopower <apss.kochi@gmail.com>

Wed, 30 Oct, 2024 at 3:33 pm

To: akhileshcyrix@gmail.com <akhileshcyrix@gmail.com>

Dear Sir,

19000+GST

Thanks & Regards

Sreekumar P N
+919895334063

A **Autopower**
Systems & Solutions

0484 - 4060102, 4060103
#57/762, Indiranagar, Kadavanthra
Kochi, Kerala - 682020
apss.kochi@gmail.com
www.ubmautopower.com



[Quoted text hidden]

Akhilesh P <akhileshcyrix@gmail.com>
To: Sreekumar Autopower <apss.kochi@gmail.com>

Fri, 1 Nov, 2024 at 8:56 am

Dear sir
Kindly share the Quotation in letter head with seal and signature.

Thanks & Regards

AKHILESH P
DISTRICT INCHARGE - PALAKKAD
Bemp-Kerala
Mobile : +91 7593847154
Email : akhileshcyrix@gmail.com

CYRIX HEALTHCARE (P) LTD
30/641B, Petta, Punithura
Ernakulam- 682038
www.cyrixhealthcare.com

[Quoted text hidden]

Sreekumar Autopower <apss.kochi@gmail.com>
To: Akhilesh P <akhileshcyrix@gmail.com>

Fri, 1 Nov, 2024 at 12:17 pm

Dear Akhilesh,

Please find attached offer.

Thanks & Regards

Sreekumar P N
+919895334063

A **Autopower**
Systems & Solutions

0484 - 4060102, 4060103
#57/762, Indiranagar, Kadavanthra
Kochi, Kerala - 682020
apss.kochi@gmail.com
www.ubmautopower.com



From: Akhilesh P <akhileshcyrix@gmail.com>

Sent: Friday, November 1, 2024 08:56

To: Sreekumar Autopower <apss.kochi@gmail.com>


Subject: Re: Fw: REQUIRED SPARE QUOTATION FOR 3KV UPS 0920202 # 142341 @ THQH CHITTUR , PALAKKAD

[Quoted text hidden]


Compactable Online UPS

20/38/2017, G.P.S. / 15

Date	Name of Equipments	Received	Issue	Balance	Main Stock Balance
7/9/18	Compactable Online Ups - 2 kva 1br back up	01	01	01	01
7/9/18			01		01 (in use)


 SUPERINTENDENT
 Muk. Head Oberlo's Hospital
 Chittur-678 101, Palakkad



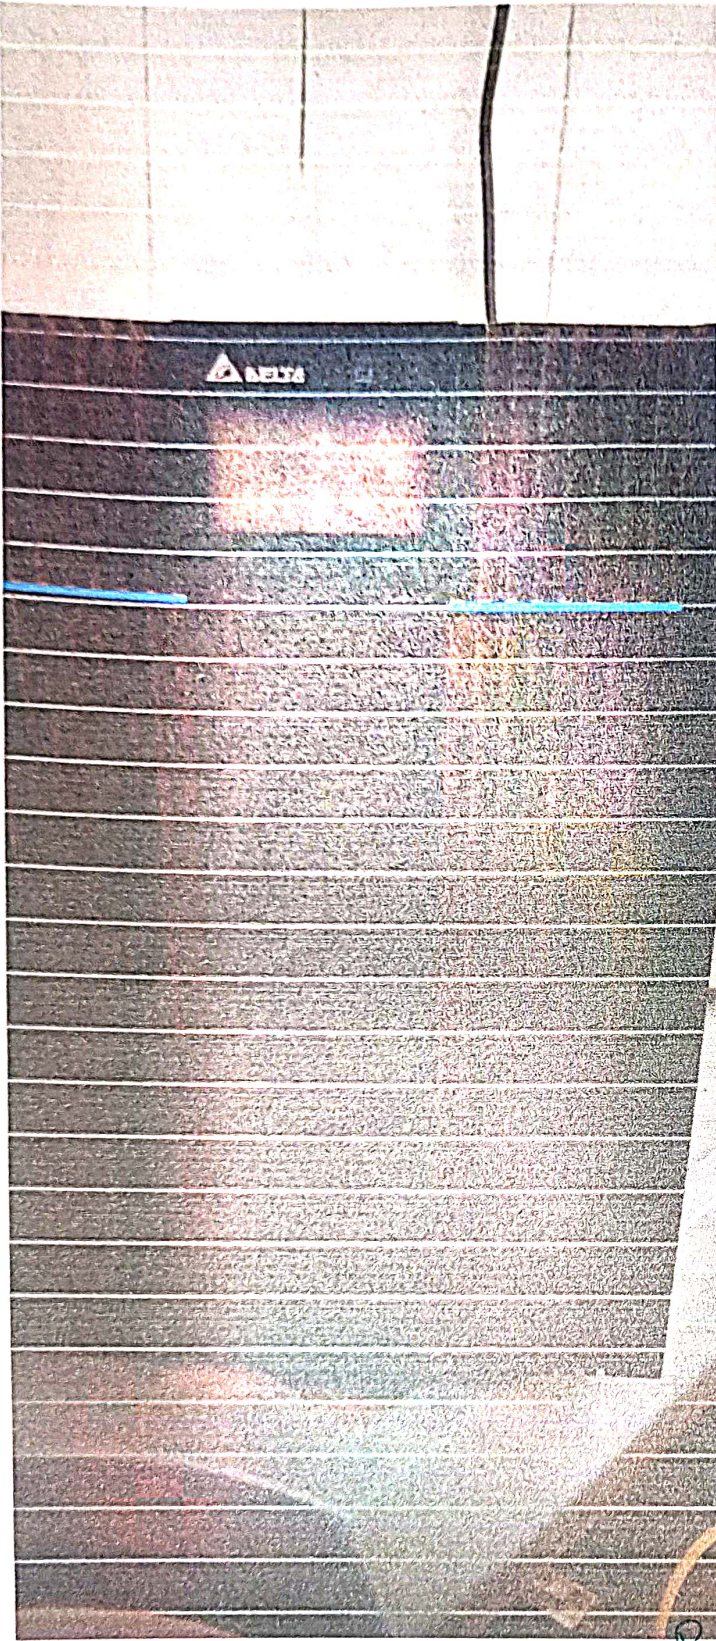

00-690
0033396
 08/20 14/2014
 MEDICAL EQUIPMENT
 MAINTENANCE PROGRAMME
 AMISCL
 DANGER:
 RISK OF ELECTRIC SHOCK
 WARNING:
 RISK OF ELECTRIC SHOCK
 ACHTUNG:
 RISK OF ELECTRIC SHOCK
 GEFAHR:
 RISK OF ELECTRIC SHOCK

CYRIX BIOMEDICAL EQUIPMENT MAINTENANCE PROGRAMME (BEMP)
 TOLL FREE NO: 1800 - 425-7680
 BAR CODE - (8004-890615225) 0920202

Risk of Voltage Back Feed
 between all terminals including the Protective Earth
 connecting to the Supply. Then check for Hazardous Voltage
 Power System (UPS) See Installation instructions before
 Before Working on this circuit Isolate Uninterruptible
 Parts Inside. Refer Servicing to Qualified Personnel
 Risk of Electric Shock. Do Not Remove Cover. No User Serviceable

DELTA - DELTA ELECTRONICS, INC.

Model No. UPS202N200zNOB0
 Model Description: N-2K
 Input: 220/230; Default: 240Vac; 50/60Hz
 10.2/9.8 (Default) 9.4A
 Output: 220/230 (Default) 240Vac; 50/60Hz
 9.1/8.7 (Default) 8.3A
 2000VA, 1800W
 Rated Conditional Short-Circuit Current (Isc) 4 kA
 Number of phases: 1 φ
 Made in China

IS 16242 (PART 1)
 IEC 62040-1
 R-11017420


CAUTION:
 RISK OF ELECTRIC SHOCK. REFER TO TOP OF
 UNIT FOR CAUTIONARY MARKINGS

S/N: REV: 03
 85117300314WC

WARNING!

While Connecting Battery Correct Polarity Should
 be Followed Connect (48VDC) Battery Recommended
 Battery = 45Ah Refer Battery Installation to Qualified Personnel
 Risk of Electric Shock. Do Not Remove Cover. No User Serviceable
 Parts Inside. Refer Servicing to Qualified Personnel

Before Working on this circuit Isolate Uninterruptible
 Power System (UPS) See Installation instructions before
 connecting to the Supply. Then check for Hazardous Voltage
 between all terminals including the Protective Earth
 Risk of Voltage Back Feed



A.P. Vasu
05/11/24
 SUPERINTENDENT
 Taluk Head Quarters Hospital
 Chittur-678 101, Palakkad