



BIOMEDICAL EQUIPMENT MAINTENANCE PROGRAMME UNDER NATIONAL HEALTH MISSION



SERVICE PROVIDER
Tender No. WO-37/2021-2022/698

No : 125593

CYRIX[®]

HEALTH CARE PVT LTD

ISO 13485 : 2012 & ISO 9001-2008 CERTIFIED COMPANY | AERB Approved Service Agency

Service Report

30/64 1 B, Petta Junction, Poonithura, Kochi- 682 038, Kerala
Ph : 98472 99500 Website : www.cyrix.com | Email : bemp.kl@cyrix.in

Health Facility: <u>General Hospital</u>	Call Registration Date: <u>21/10/24</u>
Address: <u>Neyyattinkara</u>	Caller ID: <u>141822</u>
<u>Tiruvandrum</u>	Date of Visit: <u>21/10/24</u>
Ph:	Asset No: <u>0112043</u>
	EQPT Name: <u>C.A.P.S.</u>
	Manufacture: <u>Soramec</u> Model: <u>DTYSE</u>
	S. No: <u>NA</u> Dept: <u>X-Ray</u>

Service Classification : Breakdown call PMS Calibration Cust. Training

Problem Identified : not working

Action Taken : checked and found that the unit is not getting on. I checked that the 6KV 19.2 Soramec tubes. 6KV 19.2 soramec changed and control PCB complete. Needs to replace these spares. to do further checking and water condition of the equipment. Expired spares removed.
Completed Date 21/10/24 Time : 1.2pm Spare Required

Spare Replaced Requested

Description	Qty.	Part Number	PR Number
1.			
2.			
3.			

Cyrix Engineer	Date	Start Time	End Time
<u>[Signature]</u>	<u>21/10/24</u>	<u>11.30 am</u>	<u>12 pm</u>
Customer Remark	Completed <input type="checkbox"/>	Pending	



Service Engineer Name : [Signature]
Signature: [Signature]
Date: 21/10/24
Contact Number: 9384211

SUPERINTENDENT
CUSTOMER GENERAL HOSPITAL
NEYYATTINKARA
Date: 21/10/24
Contact Number: 984720988
Designation: Receptionist
Hospital Seal

**PROFORMA
RECOMMENDATION FOR BEYOND ECONOMIC REPAIR (RBER)
BIOMEDICAL EQUIPMENT MAINTENANCE PROGRAM (BEMP)**

Name of Hospital: GENERAL HOSPITAL NEYYATTINKARA	Name of District: Thiruvananthapuram
Name of Equipment: UPS	Equipment ID & Barcode: 141872 & 0112943
Make: SOCOMEC	Model: ITYSE
Serial Number: NA	Warranty details: No Warranty
Date of purchase/ Year of manufacture/ Installation Date: 20/07/2018	Present status of the equipment: Fully Damaged
Date of breakdown: 21/10/2024(Toll free) (Date of registration of complaint through email/ Toll free)	*AMC/ CAMC Period agreed at the time of purchase: No AMC/CAMC

Action taken: Checked and found that the unit is not getting ON. Identified that the 6KVA 192 Socomec Driver, 6KVA 192 Socomec Charger and Control PCB complaint. Needs to replace these spares for further checking and working condition of the equipment. Enquired spares from vendor.

Recommendations for repair (required service details): Not recommending for repair.

Cost of spares (specify parts and cost):

1. 6KVA 192 Socomec - 19470/-
2. 6KVA 192 Socomec - 14750/-
3. Control PCB - 4130/-

Total - 38350/-

# Percentage value of the cost of spares with respect to Cost of Purchase/ Asset Value: 81.9%	Asset Value: 46774/-
---	----------------------

Abstract of Service Report provided by the OEM/ Authorized Service Provider/ CYRIX (Attached or Not):
Cyrix service report and vendor quotation attached


Reasons for recommending the equipment as BER: Checked and found 6KVA 192 Socomec Driver, 6KVA 192 Socomec Charger and Control PCB complaint. The equipment was installed on 20/07/2018 and covered up to 6+ years. The repair cost is 81.9%. As per the tender clause 5.3.14.1 both criteria met. So recommending the unit for condemnation.

[Signature]
Name & Signature of CYRIX Authority with date

Remarks of Junior Consultant (Biomedical) NHM:
Verified the quotation and charger and control PCB damaged.
... can be RBER as per criteria.
Date of complaint : 21-10-2024 . Submission MOHAN M.R. (Biomedical)

Recommended for BER (Yes/ No):	<p align="center">MANEESH MOHAN M.R. Junior Consultant (Biomedical) National Health Mission Thiruvananthapuram Signature of JC BM (NHM)</p>
Date: 7-12-2024	

Date: _____ Seal _____ Signature of Superintendent / Medical Officer (i/c)

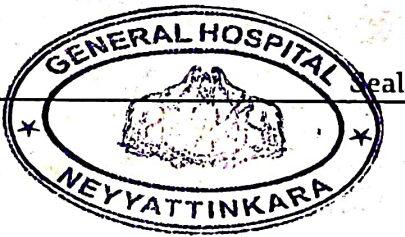

**SUPERINTENDENT
GENERAL HOSPITAL
NEYYATTINKARA-695121**

CR Machine (FUJI)

35
(machine installed on 20/12/17 due to delayed installation issued for report of balance on 20/12/18)

(start date)
Installation Date

Quantity

issued for

Balance

29.12.2017

29.12.2017 1. 3-tray fare Drypix plus printer

Multiloader Cassette reader unit

Console Advance Hp computer

Barcode scanner

Cassette : 12x14 → 2 nos. TAN No: TVDT01756 G

12x10 → 2 nos

10x8 → 2 nos.

Model No: project cs plus → 66770366

Dx plus → 76315812

Software version → 4.5.10.0

Console version → 10.0

HP workstation → 710 ps

29.12.2017

Issued for use

MLC

20/12/18

Fuji Computer Fuji Computer Radiography system accessories HSN/SAC Code 90229090

Rate

210152/2

Quantity one

Price 210152.00

(Page no 319 Book No: 5)

5/12/19

Received from store

Fuji Computer Accessories



Keyboard

1

SUPERINTENDENT
GENERAL HOSPITAL
YATTINKARA
dated 30.3.23.

AION BACKUPS

YP/VIII/320 AYLARA, KERALA KOLLAM

Date: 22/11/2024

Contact: 8921950217

Email: aionbackups12@gmail.com

GSTIN: 32CGUPM9450L1ZN

6KVA SOCOMEK ONLINE UPS SERVICE PROPOSAL

TO,

CYRIX HEALTH CARE PVT .LTD

Dear Sir/Madam,

We are pleased to submit here with our quote for the same as per below.

SL	DESCRIPTION	QTY	UNIT RATE IN INR	TOTAL	GST	TOTAL PRICE IN INR
1	6KVA 192 SOCOMEK DRIVER	1	16500.00	16,500.00	18	19,470.00
2	6KVA 192 SOCOMEK CHARGER	1	12500.00	12500.00	18	14,750.00
3	CONTROL PCB	1	3500.00	3,500.00	18	4,130.00
PAYABLE AMOUNT						38,350.00

Commercial terms and conditions

1. Payment 80% advance along with PO balance before dispatch, 20% after installation.
2. Delivery period; 2weeks.
3. Tax :GST@18% for spares,28%@Battery
4. Installation; Our scope.

Please arrange to release the PO at our above address




Bank name :HDFC Account no:50200082743176 IFSC Code:HDFC0004083

We hope you will find the above offer in line with our discussions and await your valuable order please free to call or mail us on above given number if any query.

Thank you, Sincerely,
BHAGATH MOHAN



SUPERINTENDENT
GENERAL HOSPITAL
NEYYATTINKARA-695121

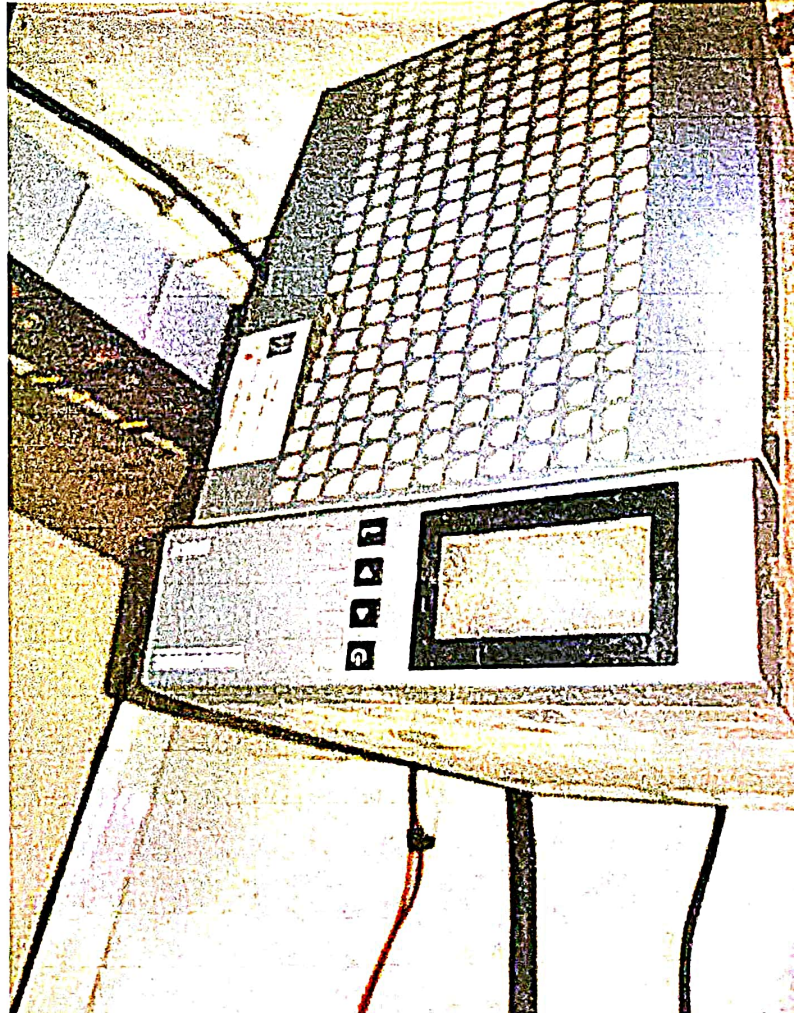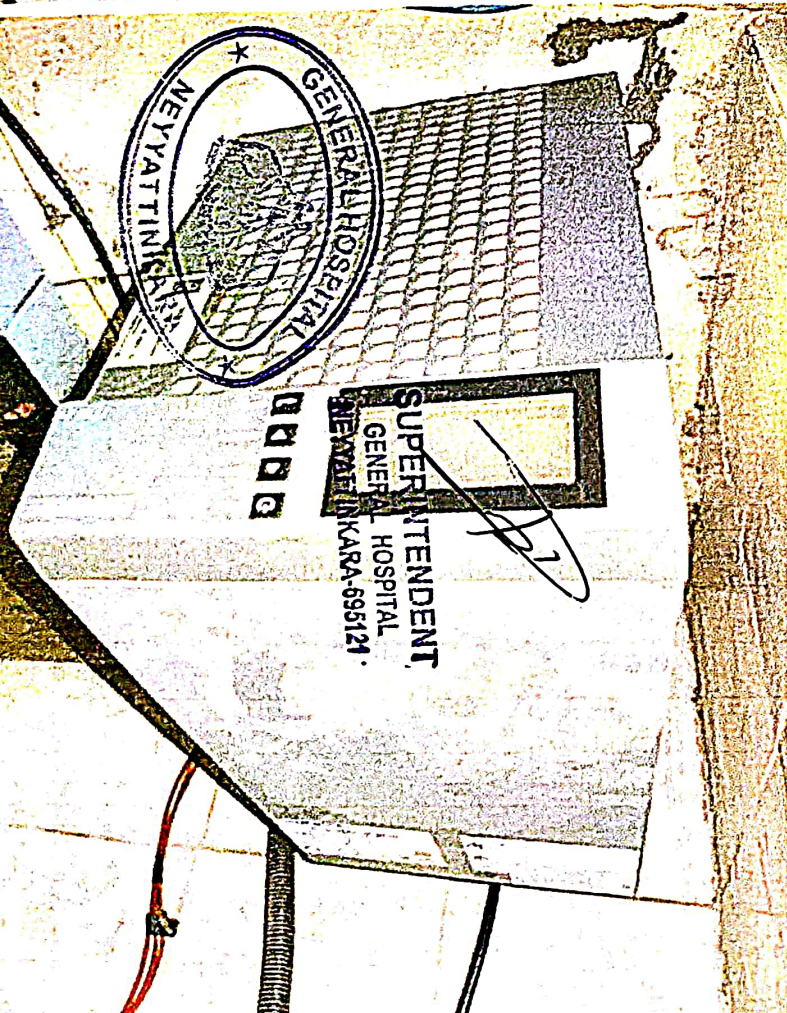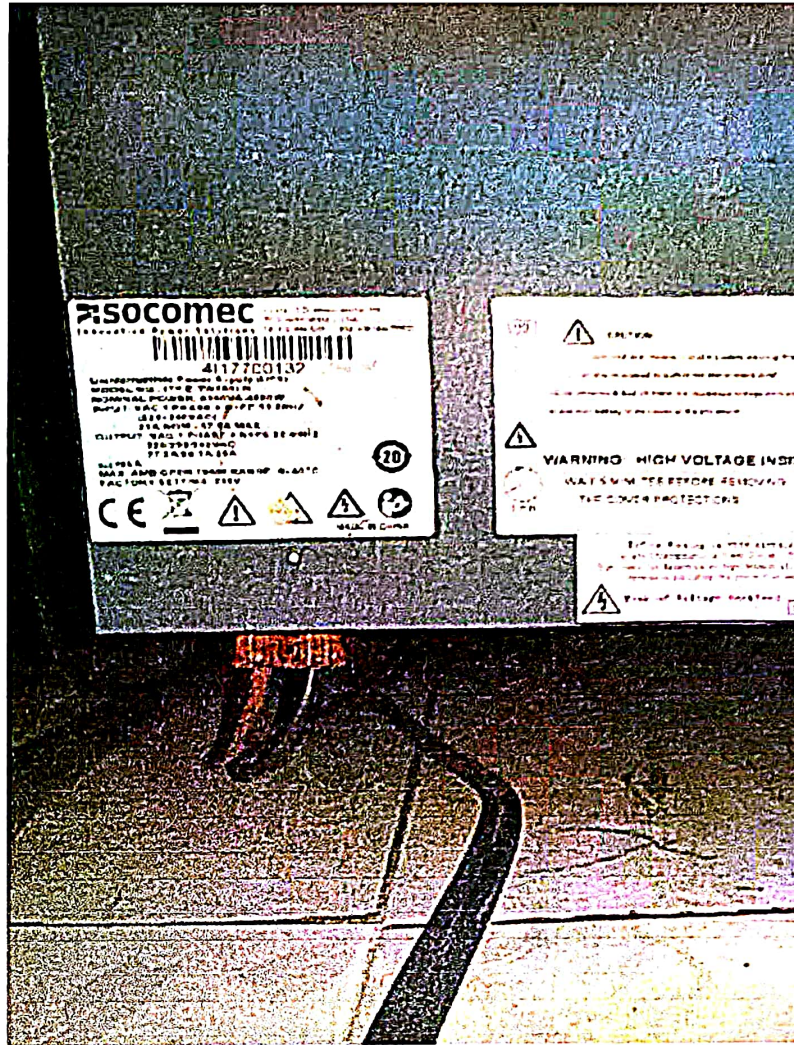



REGARDING SPARE/SERVICE QUOTATION FOR UPS-GH NEYYATINKARA- SOCOMEK-141872-0112943

1 message

Kasyep P V <kasyepcyrix@gmail.com>
To: aionbackups12@gmail.com
Cc: Afsal Yunuze <zm1.klbemp@cyrix.in>

Mon, 25 Nov 2024 at 1:55 pm

Dear Sir,
Please provide the spare/service quotation for the UPS at GH Neyyatinkara ;
Make : Socomec
Model : ITYS E

Thanks & Regards,

KASYEP PV
District Incharge ,Trivandrum
CYRIX HEALTHCARE Pvt.Ltd
KLBEMP
Ph : +91 7593847134
kasyepcyrix@gmail.com



REGARDING SPARE/SERVICE QUOTATION FOR UPS-GH NEYYATINKARA- SOCOMEK-141872-0112943

1 message

Bhagath Mohan <aionbackups12@gmail.com>
To: Kasyep P V <kasyepcyrix@gmail.com>

Tue, 26 Nov 2024 at 8:14 am

Thanks & Regards

Bhagath Mohan
PH:-8921950217

[Quoted text hidden]